


## Cold unit – Instructions for usage



Typical control panel layout (can vary from unit to unit):

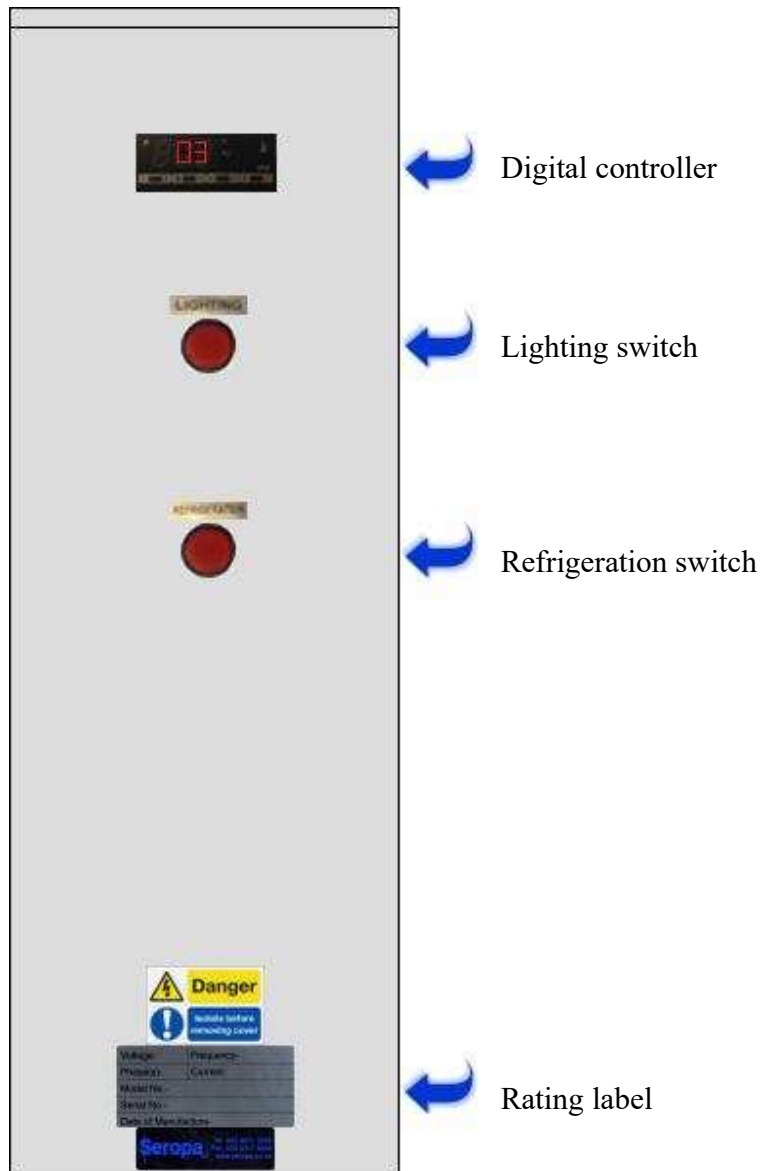

**Digital controller** – This is used to display the temperature inside the refrigerated cupboard / refrigerated well. The digital controller will only illuminate when the unit is switched on by pressing the refrigeration switch.

The default setting when the unit leaves the factory is 3°C, unless otherwise specified before or during the manufacturing process. This setting can be altered by pressing the first button on the controller, which is marked with an [i], keeping this button pressed, use the second and third buttons, which are marked with down and up arrows to alter the temperature to the desired value.

**Lighting switch** – This is used to power on the fluorescent lighting in overhead gantries. More than one switch may be present if the gantry has more than one tier or if the gantry has been divided into sections.

**Rating Label** – The rating label contains information such as voltage, frequency, phases and current, all of which will enable you to ensure that an adequate electrical supply is connected to the equipment.

The model number, serial number and date of manufacture will assist you when you need to discuss parts, servicing, etc at any point during the life of the equipment.

*Seropa Ltd,*  
*Unit 15, Hailey Road, Erith, Kent, DA18 4AA*  
*T: 020 8311 9069 E: [admin@seropa.co.uk](mailto:admin@seropa.co.uk) W: [www.seropa.co.uk](http://www.seropa.co.uk)*